

GEOTECHNICAL INVESTIGATION REPORT

**No. 8 Jayne Street
West Ryde, NSW**

Prepared for

**Apisc Group
c/- WEN Architects**

Reference No. ESWN-PR-2022-1201

17th January 2022

Geotechnical Engineering Services

- *Geotechnical investigation*
- *Lot classification*
- *Geotechnical design*
- *Excavation methodology and monitoring plans*
- *Footing inspections*
- *Slope stability analysis*
- *Landslide risk assessment*
- *Finite element analysis (FEA)*



ESWNMAN PTY LTD

ABN 70 603 089 630

PO Box 6, Ashfield NSW 1800

Telephone +61 2 7901 5582

Email info@eswnman.com.au

<http://www.eswnman.com.au>

CONTROLLED DOCUMENT**DISTRIBUTION AND REVISION REGISTER**

Revision	Details	Date	Amended By
00	Original	17/01/2022	

©ESWNMAN Pty Ltd (ESWNMAN) [2014].

Copyright in the drawings, information and data recorded in this document (the information) is the property of ESWNMAN Pty Ltd. This document and the information are solely for the use of the authorised recipient and may not be used, copied or reproduced in whole or part for any purpose other than that for which it was supplied by ESWNMAN. ESWNMAN makes no representation, undertakes no duty and accepts no responsibility to any third party who may use or rely upon this document or the information.

Author: Jiameng Li

Signed: *JLi*

Date: 17/01/2022

TABLE OF CONTENTS

1. INTRODUCTION	5
1.1 Available Information	5
1.2 Proposed Development	5
1.3 Scope of Work	5
2. SITE DESCRIPTION.....	6
3. LOCAL GEOLOGY.....	6
4. METHODOLOGY OF INVESTIGATION.....	7
4.1 Pre-fieldwork	7
4.2 Borehole Drilling	7
4.3 Dynamic Cone Penetrometer (DCP) Test	7
5. RESULTS OF INVESTIGATION.....	8
5.1 Surface Conditions	8
5.2 Subsurface Conditions	8
5.3 Groundwater	9
6. GEOTECHNICAL ASSESSMENT.....	9
6.1 Site Classifications.....	9
6.2 Excavation Conditions and Stability	10
6.3 Earth Retaining Structures	11
6.4 Foundations	12
6.5 Foundation/subgrade Preparation.....	13
6.6 Earthworks and Material Use	13
6.7 Comments on Site Instability and Control Measures	14
7. CONCLUSIONS AND RECOMMENDATIONS	15
8. LIMITATIONS.....	16

LIST OF TABLES

Table 1 - Subsurface Conditions at Testing Locations	8
Table 2 - Preliminary Geotechnical Design Parameters for Retaining Walls	11
Table 3 - Preliminary Coefficients of Lateral Earth Pressure	11
Table 4 - Preliminary Geotechnical Foundation Design Parameters	12

LIST OF APPENDICES

APPENDIX A	SITE LOCATION PLAN
APPENDIX B	SITE PHOTOGRAPHS
APPENDIX C	ENGINEERING BOREHOLE LOGS AND EXPLANATORY NOTES
APPENDIX D	RESULTS OF CONE PENETROMETER(DCP) TEST
APPENDIX E	LIMITATIONS OF GEOETCHNICAL INVESTIGATION

REFERENCES

1. Australian Standard – AS 1726-2017 Geotechnical Site Investigation.
2. Australian Standard AS 1289.6.3.2 – Determination of the penetration resistance of a soil – 9 kg dynamic cone penetrometer test.
3. Australian Standard – AS 2870-2011 Residential Slabs and Footings.
4. Australian Standard – AS 2159-2009 Piling - Design and Installation.
5. Australian Standard – AS 3798-2007 Guidelines on Earthworks for Commercial and Residential Developments.
6. Australian Standard – AS 1170.4-2007 Structural Design Actions – Part 4: Earthquake actions in Australia.
7. Australian Standard – AS 4678-2002 Earth-retaining Structures.
8. ‘NSW WorkCover: Code of Practice – Excavation’ July 2015.
9. Pells, P.J.N, Mostyn, G. & Walker B.F., “Foundations on Sandstone and Shale in the Sydney Region”, Australian Geomechanics Journal, 1998.
10. Austroads – “Pavement Design – A Guide to the Structural Design of Road Pavements”, 2004.
11. CSIRO, BTF 18 - “Foundation Maintenance and Footing Performance: A Homeowner’s Guide”.
12. City of Ryde, Slope Instability Risk Zones.
13. Australian Geomechanics Society, Landslide Risk Management Sub-Committee Guidelines: Landslip Risk Management Concepts and Guidelines, March 2007.

1. INTRODUCTION

ESWNMAN Pty Ltd (ESWNMAN) was commissioned by Apisc Group c/- WEN Architects to undertake a geotechnical investigation at No. 8 Jayne Street, West Ryde, NSW 2114. The fieldwork was completed on 7th January 2022 by ESWNMAN staff under the supervision of an experienced Geotechnical Engineer.

The purpose of investigation was to assess feasibility of the site in geotechnical prospective for a proposed residential development.

This report presents results of investigation & in-situ tests, interpretation & assessments and recommendations.

1.1 Available Information

The following information was provided to ESWNMAN prior to the fieldwork:

- Architectural drawings titled “Proposed Double Storey Dual Occupancy, 8 Jayne Street, West Ryde, NSW 2114” prepared by WEN Architects, referenced Project No. 1868, including drawing nos. DA-001 to DA-610 (22 sheets), Revision K and dated 5th January 2022.
- A site survey plan titled “Detail Survey, 8 Jayne Street, West Ryde, NSW 2114” prepared by Tigo Surveys Pty Ltd, referenced drawing No. 21028-01 and dated 28th February 2021.

1.2 Proposed Development

The design drawings provided referenced in Section 1.1 indicate the proposed development will include demolition of existing structures, subdivision of the land and construction of a two storey dual occupancy on a gentle sloping ground.

1.3 Scope of Work

The fieldwork of geotechnical investigation was undertaken by ESWNMAN staff, including the following:

- Desktop study on local geology and our in-house dataset near the subject site;
- Collection and review of Dial-Before-You-Dig (DBYD) plans;
- A site walkover to assess site accessibility and surface conditions, identify relevant site features, and nominate borehole and testing locations;

- Drilling of boreholes, identified as BH1 to BH4 inclusive, to check thickness of fill and property of natural soils;
- Performing of Dynamic Cone Penetrometer (DCP) Test at four(4) locations positioned next to boreholes to assess strength of soils with depth and rock profile;
- Geotechnical logging of materials retrieved from boreholes by an experienced Geotechnical Engineer;
- Reinstatement of site with drilling spoils;
- Interpretation of investigation data obtained; and
- Preparation of a geotechnical report.

The approximate locations of boreholes and DCP test completed are shown on Figure 1 – “Site location Plan” as included in Appendix A of this report. Selected site photographs recorded during site investigation are provided in Appendix B.

2. SITE DESCRIPTION

The site is located within City of Ryde Council area, approximately 15.1km to the northwest of Sydney CBD, 530m to the north of Marsden High School and 220m to the south of Brush Farm Park.

The site is identified as Lot 15 in Deposited Plan(DP)28606, with an approximate area of 937.8m². At time of investigation, the site was occupied by a one & two storey brick dwelling.

The site is characterised by a gently sloping ground, with a slope angle of 11° on average towards the southeast.

Selected site photographs recorded during site investigation are provided in Appendix B.

3. LOCAL GEOLOGY

Reference to the Sydney 1:100,000 Geological Series Sheet 9130 (Edition 1), dated 1983, by the Geological Survey of New South Wales, Department of Mineral Resources, indicates the site is located within an area underlain by Triassic Age Ashfield Shale Formation (Rwa) of the Wianamatta Group. The Ashfield Shale is described as “Black to dark grey shale and laminite.”

Results of the investigation provided in Section 5.2 confirmed the published geology.

4. METHODOLOGY OF INVESTIGATION

4.1 Pre-fieldwork

Prior to the commencement of fieldwork, a desktop study on local geology and review of our in-house dataset near the subject site was undertaken.

A 'Dial Before You Dig' (DBYD) underground services search was also conducted with plans reviewed on-site prior to in-situ tests.

4.2 Borehole Drilling

At time of investigation, four(4) boreholes, identified as BH1 to BH4 inclusive, were completed to check the thickness of fill and property of natural soils, to a refusal depth between 1.0m and 1.5m below the existing ground level (BGL), using a hand operated equipment assisted with in-situ tests.

The borehole locations are shown on Figure 1 attached in Appendix A. Engineering logs of boreholes processed using Bentley gINT software together with borehole explanatory notes are presented in Appendix C.

4.3 Dynamic Cone Penetrometer (DCP) Test

The Dynamic Cone Penetrometer (DCP) Test involves hammering cone tipped rods using a standard weight and drop height. The number of blows required to penetrate each 100 mm is recorded (Reference 2). The DCP test is used to assess in-situ strength of undisturbed soil and/or compacted materials. The penetration rate of the 9-kg DCP can be used to estimate in-situ CBR (California Bearing Ratio) and to identify strata thickness and other material characteristics.

A total of four(4) DCP tests positioned next to boreholes and denoted as DCPs 1 to 4 accordingly, were also completed during site investigation. DCP tests reached refusal depth of 1.5m, 1.9m, 2.7m and 1.7m BGL at location of DCPs 1 to 4 respectively.

The location of DCP test is shown on Figure 1 attached in Appendix A. The record of DCP test results is presented in Appendix D.

All fieldwork was supervised on a full time basis by an experienced Geotechnical Engineer who was responsible for nominating locations of boreholes and DCP tests, preparing field engineering logs of the subsurface strata encountered in accordance with AS 1726 for

Geotechnical Site Investigation (Reference 1), undertaking in-situ tests and taking site photographs.

The approximate reduced levels of boreholes & DCP tests, which were estimated based on the survey plan provided as referenced in Section 1.1, are presented in the attached Engineering logs and record sheet of DCP tests.

5. RESULTS OF INVESTIGATION

5.1 Surface Conditions

At time of investigation, apart from existing dwelling, retaining walls, concrete driveway and paved areas, the remainder of outdoor areas was covered with grass and lawn.

5.2 Subsurface Conditions

Based on borehole information and interpreted results of DCP tests, subsurface conditions encountered mainly consisted of the following:

- **Fill (Unit 1):** Clayey SAND, fine-medium grained, some gravel, loose, underlain by silty/sandy CLAY, low plasticity, grey, some rootlets associated with topsoil near surface, moist, poorly compacted, approximately extending to 1.2m, 0.7m, 0.6 and 0.5m BGL at location BH1 to BH4 respectively; overlying
- **Residual Soils (Unit 2):** Silty CLAY, low plasticity, brown, varying from “stiff” to “hard” consistency with depth, extending to inferred top of rock at an approximate depth of 1.5m, 1.9m, 2.7m and 1.7m BGL at location of DCPs 1 to 4 respectively; overlying
- **Weathered Shale (Unit 3):** Class V SHALE, grey, extremely weathered, extremely low and low strength. Classification of rock was carried out in accordance with Pells et al (Reference 9).

The subsurface conditions described above are also summarised in Table 1 below.

Table 1 – Subsurface Conditions at Testing Locations

Geotechnical Unit and Description			Inferred Depth to Top of Unit (m, BGL)			
			BH1/ DCP1	BH2/ DCP2	BH3/ DCP3	BH4/ DCP4
Fill (Unit 1)		Clayey SAND/silty CLAY, poorly compacted	0	0	0	0
Residual Soils (Unit 2)	Unit 2a	Silt CLAY, stiff	1.2	0.7	0.6	0.5
	Unit 2b	Silty CLAY, very stiff & hard	1.3	1.5	1.8	1.3
Weathered Shale (Unit 3)		Class V SHALE, extremely low and low strength	1.5	1.9	2.7	1.7

5.3 Groundwater

No groundwater was encountered during drilling of any boreholes up to 1.5m BGL. No water seepage/inflow or wet soil materials were observed on DCP tools up to 2.7m BGL when DCP accessories were extracted onto ground surface upon completion of DCP tests.

6. GEOTECHNICAL ASSESSMENT

The main geotechnical aspects associated with proposed development are assessed to include the following:

- Site classifications;
- Excavation conditions and stability;
- Earth retaining structures;
- Foundations;
- Foundation/subgrade preparation;
- Earthworks and material use; and
- Comments on site stability and hillside construction.

The assessment of geotechnical aspects listed above and recommendations for the proposed development are presented in the following sections.

6.1 Site Classifications

(a) Site reactive classification

Based on ground profile of the site and the criteria specified in AS 2870 (Reference 3), the site is assessed as Class “M” – “Moderately reactive clay or silt sites” with moderate ground movement from moisture changes, provided that our recommendations in **Section 6.4 – “Foundations”** are adopted during design and construction.

The above classification and footing recommendations are provided on the basis that the performance expectations set out in Appendix B of AS2870 are accepted.

Design, construction and maintenance of plumbing, ground drainage, protection of building perimeter, the garden, etc. should be carried out in accordance with CSIRO BTF18 (Reference 11) to avoid any water related problems or significant changes of moisture in building foundations, which may contribute to surface movement.

(b) Site earthquake classification

The results of investigation indicate the presence of fill, alluvium, residual soils, underlain by weathered shale. In accordance with Australian Standard AS1170.4 (Reference 6), the site sub-soil may be classified as a “Shallow soil site” (Class C_e) for design of foundations and retaining walls embedded in the soils or “Rock site” (Class B_e) for design of foundations and retaining walls embedded in the underlying rock. The Hazard Factor (Z) for Ryde in accordance with AS1170.4 is considered to be 0.08.

6.2 Excavation Conditions and Stability

The design information for the proposed development in Section 1.2 indicates cut/fill for proposed ground floor level, footing excavation (such as piers/piles) and trench excavation for installation of underground sewer/water/stormwater pipes, through Fill (Unit 1), Residual Soils (Unit 2) and Weathered Shale (Unit 3), would be required during construction.

Any fill and deleterious materials, including old footings/buried structures, concrete slabs, plant/tree roots, redundant services, timber/brick materials, are expected to be stripped and removed from development area to spoils.

Excavation of soils (Units 1 & 2) and Weathered Shale (Unit 3) will be typically feasible using conventional earthmoving equipment.

Based on groundwater conditions in Section 5.3, we assessed it is unlikely to encounter groundwater during construction excavation.

For shallow excavations(i.e. <1.5 m in depth), it should be carried out in accordance with the ‘NSW WorkCover: Code of Practice – Excavation’ (Reference 8).

Temporary excavations away from site boundaries through the underlying fill and natural soils to a maximum depth of 1.5m, may be excavated near vertical provided that:

- They do not encroach ZOI(Zone of Influence, defined as 45° angle of draw from nearest edge of footing underside) of any site or adjoining structures;
- They are barricaded when not in use;
- They are not left open for more than 24 hours;
- No surcharge loading is applied within 1.5m of the edge of the excavation;
- No groundwater flows are encountered; and

- They are not used for access by a worker.

Where access is required for workers, the temporary excavation batters should be re-graded to no steeper than 2 Horizontal (H) to 1 Vertical (V) for the soils above the natural groundwater level, or supported by a suitable temporary shoring measure.

Any permanent excavation (or filling) greater than 0.6m in height should be retained by a permanent retaining wall to be designed by a qualified Engineer based on recommendation provided in Section 6.3 below.

6.3 Earth Retaining Structures

The earth retaining structure should be designed to withstand the applied lateral pressures of the subsurface layers, the existing surcharges in their zone of influence, including existing structures, construction machines, traffic and construction related activities. The design of retaining structures should also take into consideration hydrostatic pressures and lateral earthquake loads as appropriate. **Filter type geofabric should be considered to be installed between backfill area of retaining wall and surrounding soils** to avoid soil erosion and to prevent the fines from entering the wall drainage system.

Earth retention structures can be designed in accordance with AS 4678 (Reference 7).

The recommended preliminary parameters for design of retaining structures are presented in Tables 2 and 3 below. The coefficients provided are based on drained conditions.

Table 2 - Preliminary Geotechnical Design Parameters for Retaining Walls

Geotechnical Unit	Unit Weight (kN/m ³)	Effective Cohesion c' (kPa)	Angle of Effective Internal Friction ϕ' (°)	Modulus of Elasticity E _{sh} (MPa)	Poisson Ratio ν
Fill (Unit 1)	17	0	30	10	0.35
Residual Soils (Unit 2)	18	5	28	30	0.35
Weathered Shale ¹ (Unit 3)	23	50	30	80	0.25

¹ - Classification of the rock in accordance with Pells et al (Reference 9).

Table 3 - Preliminary Coefficients of Lateral Earth Pressure

Geotechnical Unit	Coefficient of Active Lateral Earth Pressure (K _a)	Coefficient of Active Lateral Earth Pressure at Rest (K _o)	Coefficient of Passive Lateral Earth Pressure (K _p)
Fill (Unit 1)	0.33	0.50	3.0
Residual Soils (Unit 2)	0.36	0.53	2.8
Weathered Shale ¹ (Unit 3)	0.33	0.50	3.0

¹ - Classification of the rock in accordance with Pells et al (Reference 9).

The coefficients of lateral earth pressure should be verified by the project Structural Engineer for design of retaining walls. Simplified calculations of lateral active (or at rest) and passive earth pressures can be carried out using Rankine's equation shown below:

$$P_a = K \gamma H - 2c\sqrt{K} \quad \text{For calculation of Lateral Active or At Rest Earth Pressure}$$

$$P_p = K_p \gamma H + 2c\sqrt{K_p} \quad \text{For calculation of Passive Earth Pressure}$$

Where:

P_a = Active (or at rest) Earth Pressure (kN/m^2)

P_p = Passive Earth Pressure (kN/m^2)

γ = Bulk density (kN/m^3)

K = Coefficient of Earth Pressure (K_a or K_o)

K_p = Coefficient of Passive Earth Pressure

H = Retained height (m)

c = Effective Cohesion (kN/m^2)

6.4 Foundations

The results of investigation and assessments indicate the ground conditions at this site are suitable for the proposed subdivision, dual occupancy and associated works.

Based on proposed development, subsurface conditions and sloping effect, we assessed **piers/piled foundations**, with building fully supported by piles founded in Unit 3 – “Weathered Shale”, is applicable for the proposed development at this site. We recommend a minimum footing embedment of 300mm should be adopted.

The preliminary geotechnical parameters recommended for design of foundations are provided in Table 4 below.

Table 4 - Preliminary Geotechnical Foundation Design Capacities and Parameters

Geotechnical Unit		Allowable End Bearing Pressure (kPa^1)	Allowable Shaft Adhesion Compression ² (kPa)	Modulus of Elasticity ($E_{s,v}$, MPa)
Fill (Unit 1)		N/A ³	N/A ³	10
Residual Soils (Unit 2)	Unit 2a	150 (Shallow footings)	15	30
	Unit 2b	250 (Piers/piles)	30	50
Weathered Shale (Unit 3)		600 (Piers/piles)	70	100

¹ With a minimum footing embedment depth=300mm into bearing stratum.

² Shaft Adhesion applicable to piles only.

³ N/A, being excavated or Not Applicable or not recommended for building structure.

Design of shallow and piled foundations should be carried out in accordance with Australian Standards AS2870 (Reference 3) and AS2159 (Reference 4).

To minimise the potential effects of differential settlement under the buildings loads, it is recommended all foundations of the proposed building should be founded on consistent materials of similar properties or rock of similar class.

Any water, debris, loose and wet materials should be removed from excavations prior to placement of reinforcement and pouring of concrete.

A Geotechnical Engineer should be engaged to inspect footing excavations to ensure foundation bases have suitable materials with adequate bearing capacity, and to check the adequacy of footing embedment/socket depth if unexpected ground conditions are encountered.

6.5 Foundation/subgrade Preparation

For service pipes or slabs to fully or partially rely on soils underneath (either existing fill or new fill), to achieve an allowable bearing capacity of 150kPa, the following is recommended:

- Excavate and re-compact Unit 1 – “Fill” ;
- Remove roots/timber and organic matters and oversized materials(if any);
- Level off the existing natural ground surface and provide proof rolling;
- Place fill materials (preferably granular materials) at loose layer of not exceeding 150mm in thickness for cohesive soils and 200mm for cohesionless materials;
- Densify the fill mechanically, using a suitable roller or compaction equipment, as a guidance, 8-10 tonnes roller by at least 10 passes or the equivalent;
- Repeat the above till proposed FLL is reached.

For compaction over a small area or inside a trench, a vibrating plate compactor is commonly used to compact and densify the subgrade/foundation areas.

The compaction for different purposes should be carried out in accordance with recommendations provided in Section 6.6 below.

6.6 Earthworks and Material Use

The excavated materials from excavation are assessed to be generally suitable for landscaping provided they are free of any contaminants.

The suitability of the site won materials or imported materials for use as engineering fill should be subject to satisfying the following criteria:

- The materials should be Virgin Excavated Natural Material (VNEM) and clean (i.e. free of contaminants, deleterious or organic material), free of inclusions of >75mm in size, high plasticity material be removed and suitably conditioned to meet the design assumptions where fill material is proposed to be used.
- The materials should satisfy the Australian Standard AS 3798 Guidelines on Earthworks for Commercial and Residential Developments (Reference 5).

As a guidance for the fill construction or subgrade preparation, the following compaction targets can be adopted:

- Moisture content of $\pm 2\%$ of OMC (Optimal Moisture Content);
- Minimum density ratio of 100% of the Maximum Dry Density (MDD) for filling within building/structural foundation areas;
- Minimum density ratio of 98% of MDD for backfilling surrounding pipes within trenches or behind retaining walls (unless otherwise specified on design drawings);
- The loose thickness of layer should not exceed 200mm for cohesionless soils; and
- For the driveway/footpath/pavement areas, minimum density ratio of 95% of MDD for general fill and 98% for the subgrade to 0.5m depth.

Design and construction of earthworks should be carried out in accordance with Australian Standard AS 3798 (Reference 5).

6.7 Comments on Site Instability and Control Measures

Based on our observation during a site walkover and elevation plans provided, the site is characterised by a gentle sloping ground, with a slope of slightly greater than 10° , which can be categorised as **“Landslip Risk Zone M1” as indicated on the City of Ryde Guidelines for Geotechnical Zoning** (Reference 12). Hazard Zone M1 represents geotechnical hazards within moderate risk zones.

To reduce the level of risk of slope instability within this site in accordance with **AGS Landslide Risk Management Concepts and Guidelines** (Reference 13), the proposed development at this site should be constructed according to the recommendations presented in this report alongside with following provisions:

- Footings for all proposed structures, such as building & retaining walls, **should be supported by piers/piles keyed into underlying stable ground adequately to reduce the risk of instability**. We assessed stable ground should be Unit 3 – “Weathered Shale”. A minimum footing embedment of 300mm into underlying bearing stratum is recommended.

- A Geotechnical Engineer should be engaged to inspect excavations to ensure the foundation bases have suitable materials with adequate bearing capacity and embedment depth.
- Filter type geofabric should be considered to be installed between backfill area of retaining wall and surrounding soils to avoid soil erosion and to prevent the fines from entering the wall drainage system.
- All stormwater systems, including pipe lines and pits should be founded in stable natural soils with surrounding areas compacted adequately. Erosion control measures should be taken for areas surrounding the stormwater system and slopes.
- Adequate surface drain and subsoil drain should be provided. Inspection and maintenance of batter slopes, erosion control and drainage system should be carried out regularly.
- Construction activities should be carefully planned and be observed by an experienced Geotechnical Engineer familiar with content of this report for further assessment of the necessary mitigation and control measures.
- Implementation of the above measures should constitute as “Hold Points”.

Provided that footing system recommended in Section 6.5, i.e. **all footings** (building and retaining walls) **to be founded in Unit 3 –“Weathered Shale” with minimum 300mm footing embedment**, and the recommendations in this report are taken into consideration during design and construction, the risk level of overall site instability due to proposed development is assessed to be “low” for life at risk and properties, which are normally acceptable level in accordance with AGS 2007 (Reference 13).

7. CONCLUSIONS AND RECOMMENDATIONS

- Results of geotechnical investigation and assessment indicate the ground conditions at this site are suitable for proposed subdivision, dual occupancy and associated works.
- We recommend a footing system consisting of **piers/piles**, founded in Unit 3 – “Weathered Shale” with minimum 300mm footing embedment, should be adopted for the proposed development at this site. The footing system and recommended geotechnical parameters for foundation are provided in Section 6.4.
- For service pipes and slabs to fully or partially rely on soils underneath (either existing fill or new fill), “Foundation/subgrade Preparation” in accordance with Section 6.5 should be implemented.

- The construction, including cut/filling, safe excavation batters, footing systems, foundation/subgrade preparation, retaining walls and earthworks, should be implemented in accordance with the recommendations provided in Section 6.
- A Geotechnical Engineer should be engaged to inspect footing excavations to ensure the foundation base have been taken to suitable materials of appropriate bearing capacity and adequate embedment depth/socket length if unexpected ground conditions are encountered.
- If our recommendations in this report are adopted during design and construction, the risk level of overall site instability due to proposed development is assessed to be “low” for properties and life at risk in accordance with AGS 2007.

8. LIMITATIONS

This report should be read in conjunction with the “Limitations of Geotechnical Investigation Statement” attached as Appendix E, which provides important information regarding geotechnical investigation, assessment and reporting. If the actual subsurface conditions exposed during construction vary significantly from those discussed in this report, this report should be reviewed, and the undersigned should be contacted for further advices.

For and on behalf of
ESWNMAN Pty Ltd




Jiameng Li
BE (Civil), MEngSc (Geotechnical), MIEAust, CPEng, NER
Principal Geotechnical Engineer
ESWNMAN PTY LTD
PO Box 6, Ashfield NSW 1800
M: +61 421 678 797 E: Jiameng@eswnman.com.au
<http://www.eswnman.com.au>



APPENDIX A

SITE LOCATION PLAN

Image source: An architectural drawing prepared by WEN Architects.

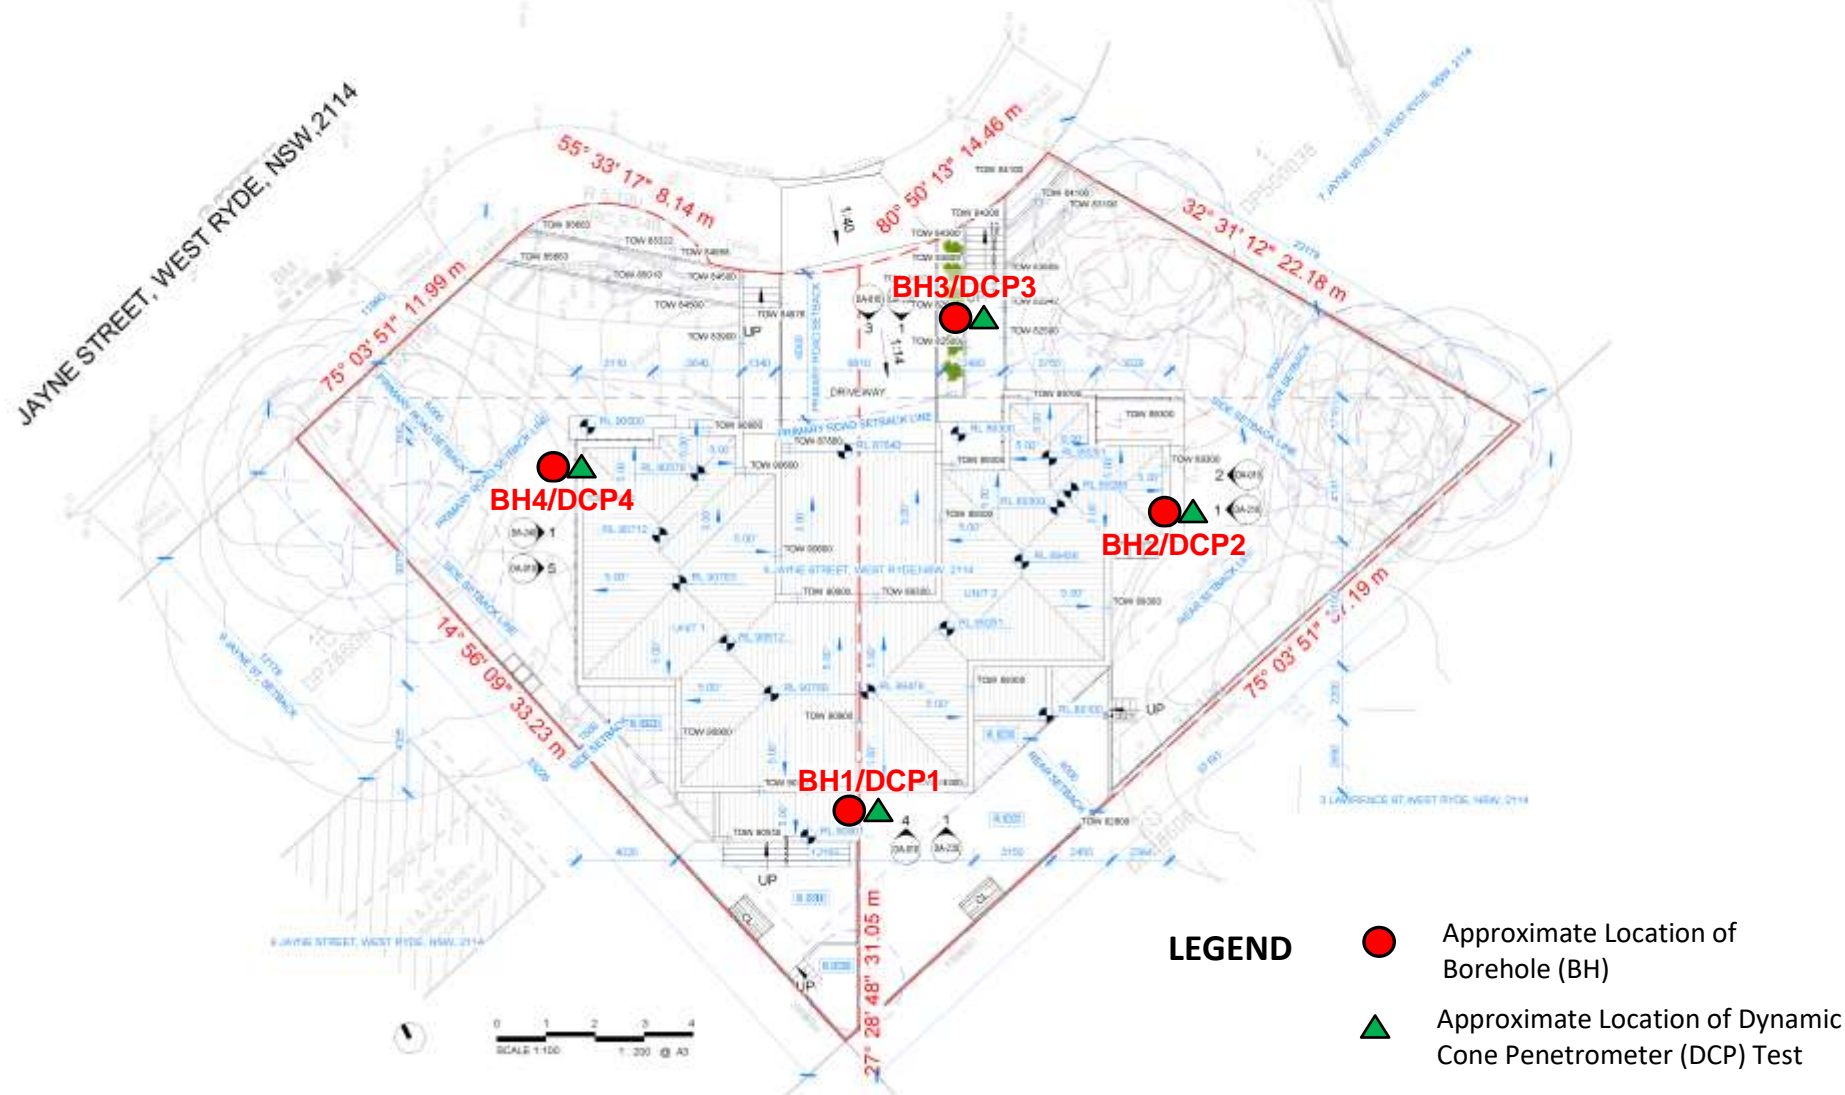

PROJECT: 8 Jayne Street, West Ryde, NSW 2114

DRAWN BY: J.L.



CLIENT: Apisc Group

PROJECT NO: ESWN-PR-2022-1201

DATE: 12th January 2022

TITLE: Site Location Plan

FIGURE 1

APPENDIX B

SITE PHOTOGRAPHS



Photograph 1

Dynamic Cone Penetrometer(DCP) Test in progress at location of DCP1 within rear garden



Photograph 2

DCP test in progress at location of DCP2 within rear garden



Photograph 3

DCP test in progress at location of DCP3 within front yard



Photograph 4

Drilling in progress at location of borehole BH4 within front yard

Appendix B Site Photographs

APPENDIX C

ENGINEERING BOREHOLE LOGS AND EXPLANATORY NOTES



ESWNMAN Pty Ltd
PO Box 6, Ashfield, NSW 1800
Telephone: 02-79015582

BOREHOLE NUMBER BH1

PAGE 1 OF 1

CLIENT	Apisc Group	PROJECT NAME	Geotechnical Investigation
PROJECT NUMBER	ESWN-PR-2022-1201	PROJECT LOCATION	8 Jayne Street, West Ryde, NSW
DATE STARTED	7/1/22	COMPLETED	7/1/22
R.L. SURFACE	82.2	DATUM	m AHD
DRILLING CONTRACTOR	ESWNMAN Pty Ltd	SLOPE	90°
BEARING	---	HOLE LOCATION	Refer to Figure 1 Site Location Plan
EQUIPMENT	Hand Auger & DCP Test	LOGGED BY	W.L.
CHECKED BY	J.L.	NOTES	Rear garden

Method	Water	RL (m)	Depth (m)	Graphic Log	Classification Symbol	Material Description	Samples Tests Remarks	Additional Observations
HA		82.0			SC	Clayey SAND, fine grained, grey, some rootlets associated with topsoil, moist, poorly compacted.		FILL
	Not Encountered		0.5		CL	Sandy CLAY, low plasticity, grey, some gravel, moist, fairly compacted.		
		81.5			SC	Clayey SAND, fine grained, grey, some gravel, moist, poorly compacted.		
			1.0					
		81.0			CL	Silty CLAY, low plasticity, brown, moist, stiff.		RESIDUAL SOILS
						Borehole BH1 terminated at 1.3m		DCP test indicates top of rock below 1.5m depth
			1.5					
		80.5						
			2.0					

BOREHOLE / TEST PIT ESWN-PR-2022-1201 GPJ GINT STD AUSTRALIA GDT 12/1/22



CLIENT	Apisc Group	PROJECT NAME	Geotechnical Investigation
PROJECT NUMBER	ESWN-PR-2022-1201	PROJECT LOCATION	8 Jayne Street, West Ryde, NSW
DATE STARTED	7/1/22	COMPLETED	7/1/22
R.L. SURFACE	81.4	DATUM	m AHD
DRILLING CONTRACTOR	ESWNMAN Pty Ltd	SLOPE	90°
BEARING	---		
EQUIPMENT	Hand Auger & DCP Test	HOLE LOCATION	Refer to Figure 1 Site Location Plan
HOLE SIZE	70mm	LOGGED BY	W.L.
CHECKED BY	J.L.		
NOTES	Rear garden		

Method	Water	RL (m)	Depth (m)	Graphic Log	Classification Symbol	Material Description	Samples Tests Remarks	Additional Observations
HA					SC	Clayey SAND, fine grained, grey, some rootlets associated with topsoil, moist, poorly compacted.		FILL
		81.0			CL	Gravelly CLAY, low plasticity, grey, some sand, moist, well compacted.		
			0.5					
					CL	Silty CLAY, low plasticity, brown, moist, stiff.		RESIDUAL SOILS
		80.5						
			1.0					
		80.0						
			1.5					DCP test indicates top of rock below 1.9m depth
						Borehole BH2 terminated at 1.5m		
		79.5						
			2.0					



ESWNMAN
25 YEARS EXPERIENCE

ESWNMAN Pty Ltd
PO Box 6, Ashfield, NSW 1800
Telephone: 02-79015582

BOREHOLE NUMBER BH3

PAGE 1 OF 1

CLIENT	Apisc Group	PROJECT NAME	Geotechnical Investigation
PROJECT NUMBER	ESWN-PR-2022-1201	PROJECT LOCATION	8 Jayne Street, West Ryde, NSW
DATE STARTED	7/1/22	COMPLETED	7/1/22
R.L. SURFACE	82.4	DATUM	m AHD
DRILLING CONTRACTOR	ESWNMAN Pty Ltd	SLOPE	90°
BEARING	---		
EQUIPMENT	Hand Auger & DCP Test	HOLE LOCATION	Refer to Figure 1 Site Location Plan
HOLE SIZE	70mm	LOGGED BY	W.L.
CHECKED BY	J.L.		
NOTES	Front yard		

Method	Water	RL (m)	Depth (m)	Graphic Log	Classification Symbol	Material Description	Samples Tests Remarks	Additional Observations
HA					GP	Blue metal.		FILL
	Not Encountered	82.0			SC	Clayey SAND, medium grained, grey, moist, poorly compacted.		
			0.5		CL	Silty CLAY, low plasticity, brown, moist, stiff.		RESIDUAL SOILS
		81.5						DCP test indicates top of rock below 2.7m depth
			1.0			Borehole BH3 terminated at 1m		
		81.0						
			1.5					
		80.5						
			2.0					

BOREHOLE / TEST PIT ESWN-PR-2022-1201 GPJ GINT STD AUSTRALIA.GDT 12/1/22



ESWNMAN
25 YEARS EXPERIENCE

ESWNMAN Pty Ltd
PO Box 6, Ashfield, NSW 1800
Telephone: 02-79015582

BOREHOLE NUMBER BH4

PAGE 1 OF 1

CLIENT	Apisc Group	PROJECT NAME	Geotechnical Investigation
PROJECT NUMBER	ESWN-PR-2022-1201	PROJECT LOCATION	8 Jayne Street, West Ryde, NSW
DATE STARTED	7/1/22	COMPLETED	7/1/22
R.L. SURFACE	84.7	DATUM	m AHD
DRILLING CONTRACTOR	ESWNMAN Pty Ltd	SLOPE	90°
BEARING	---	HOLE LOCATION	Refer to Figure 1 Site Location Plan
EQUIPMENT	Hand Auger & DCP Test	LOGGED BY	W.L.
CHECKED BY	J.L.	NOTES	Front yard

Method	Water	RL (m)	Depth (m)	Graphic Log	Classification Symbol	Material Description	Samples Tests Remarks	Additional Observations
HA					SC	Clayey SAND, medium grained, grey, some rootlets associated with topsoil, moist, poorly compacted.		FILL
		84.5						
					CL	Sandy CLAY, low plasticity, grey, some gravel, moist, fairly compacted.		
			0.5					
					CL	Silty CLAY, low plasticity, brown, moist, stiff.		RESIDUAL SOILS
		84.0						
			1.0					
					CL	Silty CLAY, low plasticity, brown, moist, very stiff.		
		83.5						
					CH	Silty CLAY, medium plasticity, brown with red mottling, moist, hard.		
			1.5					DCP test indicates top of rock below 1.7m depth
						Borehole BH4 terminated at 1.5m		
		83.0						
			2.0					

BOREHOLE / TEST PIT ESWN-PR-2022-1201 GPJ GINT STD AUSTRALIA GDT 12/1/22


Explanatory Notes – Description for Soil

In engineering terms soil includes every type of uncemented or partially cemented inorganic material found in the ground. In practice, if the material can be remoulded by hand in its field condition or in water it is described as a soil. The dominant soil constituent is given in capital letters, with secondary textures in lower case. The dominant feature is assessed from the Unified Soil Classification system and a soil symbol is used to define a soil layer.

METHOD

Method	Description
AS	Auger Screwing
BH	Backhoe
CT	Cable Tool Rig
EE	Existing Excavation/Cutting
EX	Excavator
HA	Hand Auger
HQ	Diamond Core-63mm
JET	Jetting
NMLC	Diamond Core –52mm
NQ	Diamond Core –47mm
PT	Push Tube
RAB	Rotary Air Blast
RB	Rotary Blade
RT	Rotary Tricone Bit
TC	Auger TC Bit
V	Auger V Bit
WB	Washbore
DT	Diatube

WATER

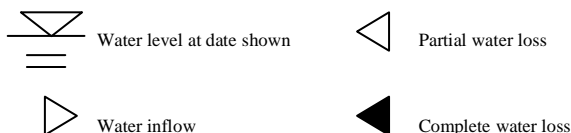

NFGWO: The observation of groundwater, whether present or not, was not possible due to drilling water, surface seepage or cave in of the borehole/test pit.

NFGWE: The borehole/test pit was dry soon after excavation. Inflow may have been observed had the borehole/test pit been left open for a longer period.

SAMPLING

Sample	Description
B	Bulk Disturbed Sample
D	Disturbed Sample
Jar	Jar Sample
SPT	Standard Penetration Test
U50	Undisturbed Sample –50mm
U75	Undisturbed Sample –75mm

UNIFIED SOIL CLASSIFICATION

The appropriate symbols are selected on the result of visual examination, field tests and available laboratory tests, such as, sieve analysis, liquid limit and plasticity index.

USC Symbol	Description
GW	Well graded gravel
GP	Poorly graded gravel
GM	Silty gravel
GC	Clayey gravel
SW	Well graded sand
SP	Poorly graded sand
SM	Silty sand
SC	Clayey sand
ML	Silt of low plasticity
CL	Clay of low plasticity
OL	Organic soil of low plasticity
MH	Silt of high plasticity
CH	Clay of high plasticity
OH	Organic soil of high plasticity
Pt	Peaty Soil

MOISTURE CONDITION

- Dry** - Cohesive soils are friable or powdery
Cohesionless soil grains are free-running
- Moist** - Soil feels cool, darkened in colour
Cohesive soils can be moulded
Cohesionless soil grains tend to adhere
- Wet** - Cohesive soils usually weakened

Free water forms on hands when handling

For cohesive soils the following codes may also be used:

- MC>PL Moisture Content greater than the Plastic Limit.
- MC~PL Moisture Content near the Plastic Limit.
- MC<PL Moisture Content less than the Plastic Limit.

PLASTICITY

The potential for soil to undergo change in volume with moisture change is assessed from its degree of plasticity. The classification of the degree of plasticity in terms of the Liquid Limit (LL) is as follows:

Description of Plasticity	LL (%)
Low	<35
Medium	35 to 50
High	>50

COHESIVE SOILS - CONSISTENCY

The consistency of a cohesive soil is defined by descriptive terminology such as very soft, soft, firm, stiff, very stiff and hard. These terms are assessed by the shear strength of the soil as observed visually, by hand penetrometer values and by resistance to deformation to hand moulding.

A Hand Penetrometer may be used in the field or the laboratory to provide an approximate assessment of the unconfined compressive strength (UCS) of cohesive soils. The undrained shear strength of cohesive soils is approximately half the UCS. The values are recorded in kPa as follows:

Strength	Symbol	Undrained Shear Strength, C_u (kPa)
Very Soft	VS	< 12
Soft	S	12 to 25
Firm	F	25 to 50
Stiff	St	50 to 100
Very Stiff	VSt	100 to 200
Hard	H	> 200

COHESIONLESS SOILS - RELATIVE DENSITY

Relative density terms such as very loose, loose, medium, dense and very dense are used to describe silty and sandy material, and these are usually based on resistance to drilling penetration or the Standard Penetration Test (SPT) 'N' values. Other condition terms, such as friable, powdery or crumbly may also be used.

Term	Symbol	Density Index	N Value (blows/0.3 m)
Very Loose	VL	0 to 15	0 to 4
Loose	L	15 to 35	4 to 10
Medium Dense	MD	35 to 65	10 to 30
Dense	D	65 to 85	30 to 50
Very Dense	VD	>85	>50

COHESIONLESS SOILS PARTICLE SIZE DESCRIPTIVE TERMS

Name	Subdivision	Size
Boulders		>200 mm
Cobbles		63 mm to 200 mm
Gravel	coarse	20 mm to 63 mm
	medium	6 mm to 20 mm
	fine	2.36 mm to 6 mm
Sand	coarse	600 µm to 2.36 mm
	medium	200 µm to 600 µm
	fine	75 µm to 200 µm

Description for Rock

The rock is described with strength and weathering symbols as shown below. Other features such as bedding and dip angle are given.

METHOD

Refer soil description sheet

WATER

Refer soil description sheet

ROCK QUALITY

The fracture spacing is shown where applicable and the Rock Quality Designation (RQD) or Total Core Recovery (TCR) is given where:

$$\text{TCR (\%)} = \frac{\text{length of core recovered}}{\text{length of core run}}$$

$$\text{RQD (\%)} = \frac{\text{Sum of Axial lengths of core > 100mm long}}{\text{length of core run}}$$

ROCK MATERIAL WEATHERING

Rock weathering is described using the abbreviations and definitions used in AS1726. AS1726 suggests the term "Distinctly Weathered" (DW) to cover the range of substance weathering conditions between (but not including) XW and SW. For projects where it is not practical to delineate between HW and MW or it is deemed that there is no advantage in making such a distinction, DW may be used with the definition given in AS1726.

Symbol	Term	Definition
RS	Residual Soil	Soil definition on extremely weathered rock; the mass structure and substance are no longer evident; there is a large change in volume but the soil has not been significantly transported
XW	Extremely Weathered	Rock is weathered to such an extent that it has 'soil' properties, ie. It either disintegrates or can be remoulded in water
HW	Highly Weathered	The rock substance is affected by weathering to the extent that limonite staining or bleaching affects the whole rock substance and other signs of chemical or physical decomposition are evident. Porosity and strength is usually decreased compared to the fresh rock. The colour and strength of the fresh rock is no longer recognisable.
DW	Distinctly Weathered (see AS1726 Definition below)	
MW	Moderately Weathered	
SW	Slightly Weathered	The whole of the rock substance is discoloured, usually by iron staining or bleaching, to the extent that the colour of the fresh rock is no longer recognisable
FR	Fresh	Rock shows no sign of decomposition or staining

"Distinctly Weathered: Rock strength usually changed by weathering. The rock may be highly discoloured, usually by iron staining. Porosity may be increased by leaching, or may be decreased due to the deposition of weathering products in pores." (AS1726)

ROCK STRENGTH

Rock strength is described using AS1726 and ISRM - Commission on Standardisation of Laboratory and Field Tests, "Suggested method of determining the Uniaxial Compressive Strength of Rock materials and the Point Load Index", as follows:

Term	Symbol	Point Load Index Is ₍₅₀₎ (MPa)
Extremely Low	EL	<0.03
Very Low	VL	0.03 to 0.1

Low	L	0.1 to 0.3
Medium	M	0.3 to 1
High	H	1 to 3
Very High	VH	3 to 10
Extremely High	EH	>10

● Diametral Point Load Index test

■ Axial Point Load Index test

DEFECT SPACING/BEDDING THICKNESS

Measured at right angles to defects of same set or bedding.

Term	Defect Spacing	Bedding
Extremely closely spaced	<6 mm	Thinly Laminated
Very closely spaced	6 to 20 mm	Laminated
Closely spaced	20 to 60 mm	Very Thin
Moderately widely spaced	0.06 to 0.2 m	Thin
Widely spaced	0.2 to 0.6 m	Medium
Very widely spaced	0.6 to 2 m	Thick
	>2 m	Very Thick

DEFECT DESCRIPTION

Type:	Definition:
B	Bedding
BP	Bedding Parting
F	Fault
C	Cleavage
J	Joint
SZ	Shear Zone
CZ	Crushed Zone
DB	Drill Break

Planarity:	Roughness:
P – Planar	R – Rough
Ir – Irregular	S – Smooth
St – Stepped	Sl – Slickensides
U – Undulating	Po – Polished

Coating or Infill:	Description
Clean	No visible coating or infilling
Stain	No visible coating or infilling but surfaces are discoloured by mineral staining
Veneer	A visible coating or infilling of soil or mineral substance but usually unable to be measured (<1mm). If discontinuous over the plane, patchy veneer
Coating	A visible coating or infilling of soil or mineral substance, >1mm thick. Describe composition and thickness

The inclinations of defects are measured from perpendicular to the core axis.

Graphic Symbols for Soil and Rock

Graphic symbols used on borehole and test pit reports for soil and rock are as follows. Combinations of these symbols may be used to indicate mixed materials such as clayey sand.

Soil Symbols

Main Components

	CLAY
	SILT
	SAND
	GRAVEL
	BOULDERS / COBBLES
	PEAT (Organic)

Minor Components

	Clayey
	Silty
	Sandy
	Gravelly

Other Symbols

	TOPSOIL
	FILL
	ASPHALT
	CONCRETE
	NO CORE

Rock Symbols

Sedimentary Rocks

	SANDSTONE
	SILTSTONE
	CLAYSTONE, MUDSTONE
	SHALE
	LAMINITE
	CONGLOMERATE
	BRECCIA
	TILL
	COAL
	LIMESTONE

Igneous Rocks

	PLUTONIC IGNEOUS (eg: Granite)
	VOLCANIC IGNEOUS (eg: Basalt)
	PYROCLASTIC IGNEOUS (eg: Ignimbrite)

Metamorphic Rocks

	SLATE, PHYLLITE, SCHIST
	GNEISS
	QUARTZITE

Engineering classification of shales and sandstones in the Sydney Region - A summary guide

The Sydney Rock Class classification system is based on rock strength, defect spacing and allowable seams as set out below. All three factors must be satisfied.

CLASSIFICATION FOR SANDSTONE

Class	Uniaxial Compressive Strength (MPa)	Defect Spacing (mm)	Allowable Seams (%)
I	>24	>600	<1.5
II	>12	>600	<3
III	>7	>200	<5
IV	>2	>60	<10
V	>1	N.A.	N.A.

CLASSIFICATION FOR SHALE

Class	Uniaxial Compressive Strength (MPa)	Defect Spacing (mm)	Allowable Seams (%)
I	>16	>600	<2
II	>7	>200	<4
III	>2	>60	<8
IV	>1	>20	<25
V	>1	N.A.	N.A.

1. ROCK STRENGTH

For expedience in field/construction situations the uniaxial (unconfined) compressive strength of the rock is often inferred, or assessed using the point load strength index (Is_{50}) test (AS 4133.4.1 - 1993). For Sydney Basin sedimentary rocks the uniaxial compressive strength is typically about 20 x (Is_{50}) but the multiplier may range from about 10 to 30 depending on the rock type and characteristics. In the absence of UCS tests, the assigned Sydney Rock Class classification may therefore include rock strengths outside the nominated UCS range.

2. DEFECT SPACING

The terms relate to spacing of natural fractures in NMLC, NQ and HQ diamond drill cores and have the following definitions:

Defect Spacing (mm)	Terms Used to Describe Defect Spacing ¹
>2000	Very widely spaced
600 – 2000	Widely spaced
200 – 600	Moderately spaced
60 – 200	Closely spaced
20 – 60	Very closely spaced
<20	Extremely closely spaced

¹After ISO/CD14689 and ISRM.

3. ALLOWABLE SEAMS

Seams include clay, fragmented, highly weathered or similar zones, usually sub-parallel to the loaded surface. The limits suggested in the tables relate to a defined zone of influence. For pad footings, the zone of influence is defined as 1.5 times the least footing dimension. For socketed footings, the zone includes the length of the socket plus a further depth equal to the width of the footing. For tunnel or excavation assessment purposes the defects are assessed over a length of core of similar characteristics.

Source: Based on Pells, P.J.N, Mostyn, G. and Walker, B.F. (1998) – Foundations on sandstone and shale in the Sydney region. Australian Geomechanics Journal, No 33 Part 3

APPENDIX D

RESULTS OF DYNAMIC CONE PENETROMETER(DCP) TEST

RESULTS OF DYNAMIC CONE PENETROMETER TEST



ESWNMAN
25 YEARS EXPERIENCE

Client:	Apisc Group	Ref No:	ESWN-PR-2022-1201
Project:	Geotechnical Investigation	Date Tested:	7/01/2022
Location:	8 Jayne Street, West Ryde, NSW 2114	Tested By:	W.L./J.L.

Depth (mm)	DCP No.				Depth (mm)	DCP No.			
	DCP1	DCP2	DCP3	DCP4		5	6	7	8
0-100	0	0	0	0	0-100				
100-200	1	1	1	1	100-200				
200-300	1	1	1	1	200-300				
300-400	2	2	1	3	300-400				
400-500	2	3	1	2	400-500				
500-600	2	5	1	3	500-600				
600-700	2	4	2	3	600-700				
700-800	1	3	3	4	700-800				
800-900	1	3	4	4	800-900				
900-1000	1	3	3	4	900-1000				
1000-1100	1	6	4	8	1000-1100				
1100-1200	1	7	3	6	1100-1200				
1200-1300	6	5	3	6	1200-1300				
1300-1400	22	3	3	13	1300-1400				
1400-1500	8	5	5	15	1400-1500				
1500-1600	Bounce	12	4	16	1500-1600				
1600-1700		16	6	21	1600-1700				
1700-1800		16	7	Bounce	1700-1800				
1800-1900		22/90mm	12		1800-1900				
1900-2000		Bounce	10		1900-2000				
2000-2100			8		2000-2100				
2100-2200			10		2100-2200				
2200-2300			12		2200-2300				
2300-2400			17		2300-2400				
2400-2500			18		2400-2500				
2500-2600			17		2500-2600				
2600-2700			22		2600-2700				
2700-2800					2700-2800				
2800-2900					2800-2900				
2900-3000					2900-3000				
3000-3100					3000-3100				
3100-3200					3100-3200				
3200-3300					3200-3300				
3300-3400					3300-3400				
2400-3500					2400-3500				
3500-3600					3500-3600				
3600-3700					3600-3700				
3700-3800					3700-3800				
3800-3900					3800-3900				
3900-4000					3900-4000				
RL (m)	82.2	81.4	82.4	84.7	RL (m)				

Notes:

DCP testing equipment designed and conducted in accordance with AS1289.6.3.2

APPENDIX E

LIMITATIONS OF GEOTECHNICAL INVESTIGATION

General

In making an assessment of a site from a limited number of boreholes or test pits there is the possibility that variations may occur between testing locations. Site exploration identifies specific subsurface conditions only at those points from which samples have been taken. The risk that variations will not be detected can be reduced by increasing the frequency of testing locations. The investigation program undertaken is a professional estimate of the scope of investigation required to provide a general profile of the subsurface conditions. The data derived from the site investigation program and subsequent laboratory testing are extrapolated across the site to form an inferred geological model and an engineering opinion is rendered about overall subsurface conditions and their likely behaviour with regard to the proposed development. Despite investigation the actual conditions at the site might differ from those inferred to exist, since no subsurface exploration program, no matter how comprehensive, can reveal all subsurface details and anomalies.

The borehole/test pit logs are the subjective interpretation of subsurface conditions at a particular location, made by trained personnel. The interpretation may be limited by the method of investigation, and cannot always be definitive.

Subsurface conditions

Subsurface conditions may be modified by changing natural forces or man-made influences. A geotechnical report is based on conditions which existed at the time of subsurface exploration.

Construction operations at or adjacent to the site, and natural events such as rainfall events, floods, or groundwater fluctuations, may also affect subsurface conditions, and thus the continuing adequacy of a geotechnical report. The geotechnical engineer should be kept apprised of any such events, and should be consulted to determine if additional tests are necessary.

Assessment and interpretation

A geotechnical engineer should be retained to work with other appropriate design professionals explaining relevant geotechnical findings and in reviewing the adequacy of their drawings/plans and specifications relative to geotechnical issues.

Information and documentations

Final logs are developed by geotechnical engineers based upon their interpretation of field description and laboratory results of field samples. Customarily, only the final logs are included in geotechnical engineering reports. These logs should not under any circumstances be redrawn for inclusion in architectural or other design drawings. To minimise the likelihood of bore/profile log misinterpretation, contractors should be given access to the complete geotechnical engineering report prepared or authorised for their use. Providing the best available information to contractors helps prevent costly construction problems.

Construction phase service (CPS)

During construction, excavation is frequently undertaken which exposes the actual subsurface conditions. For this reason geotechnical consultants should be retained through the construction stage, to identify variations if they are exposed and to conduct additional tests which may be required and to deal quickly with geotechnical problems if they arise.

Report

The report has been prepared for the benefit of the client and no other parties. ESWNMAN PTY LTD assumes no responsibility and will not be liable to any other person or organisation for or in relation to any matter dealt with or conclusions expressed in the report, or for any loss or damage suffered by any other person or organisation arising from matters dealt with or conclusions expressed in the report (including without limitation matters arising from any negligent act or omission of ESWNMAN PTY LTD or for any loss or damage suffered by any other party relying upon the matters dealt with or conclusions expressed in the report). Other parties should not rely upon the report or the accuracy or completeness of any conclusions and should make their own enquiries and obtain independent advice in relation to such matters.

Other limitations

ESWNMAN PTY LTD will not be liable to update or revise the report to take into account any events or emergent circumstances or facts occurring or becoming apparent after the date of the report.